


CONSULT LOAD DESIGN CHARTS
FOR ALLOWABLE PANEL SPANS

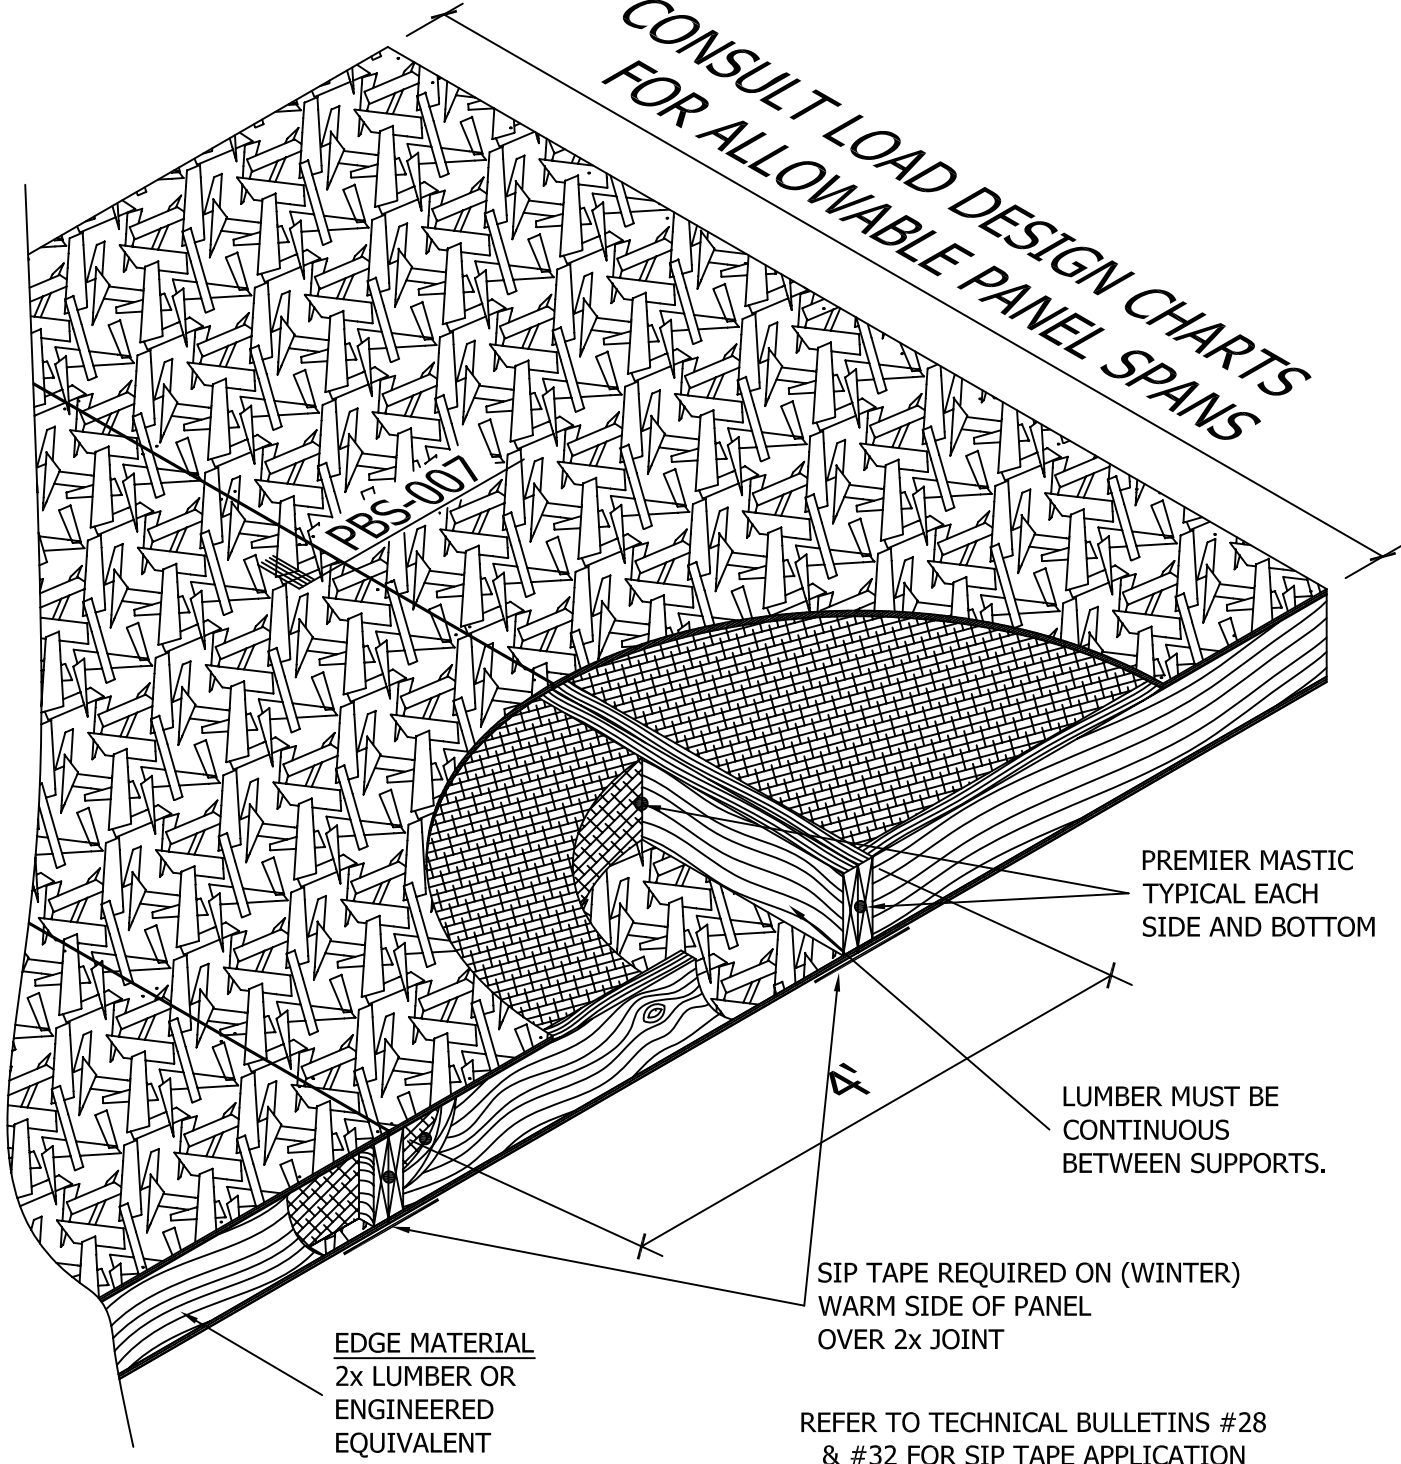


PREMIER MASTIC
TYPICAL EACH
SIDE AND BOTTOM

LUMBER MUST BE
CONTINUOUS
BETWEEN SUPPORTS.

SIP TAPE REQUIRED ON (WINTER)
WARM SIDE OF PANEL
OVER 2x JOINT

REFER TO TECHNICAL BULLETINS #28
& #32 FOR SIP TAPE APPLICATION

EDGE MATERIAL
2x LUMBER OR
ENGINEERED
EQUIVALENT



2x PANEL JOINT CONNECTION

PREMIER BUILDING SYSTEMS

11-9-10